

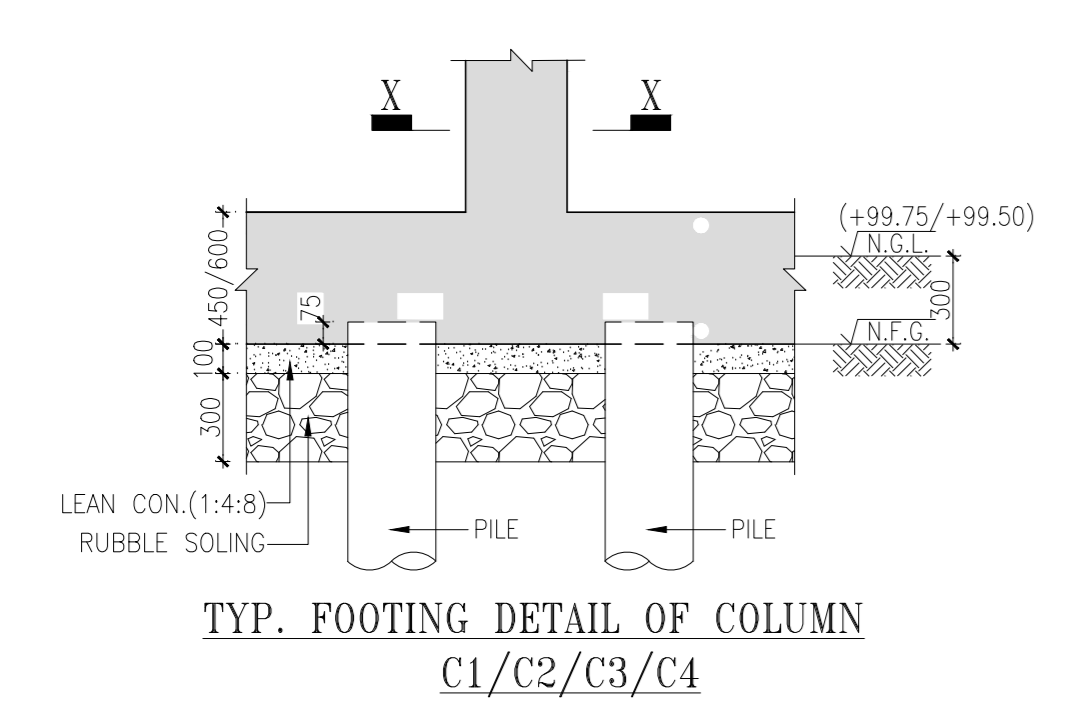


COLUMN SCHEDULE		GRADE BEAM SCHEDULE	
COLUMN	SIZE	BEAM	SIZE
C1	230x345	GB1	1000x600
C2	230x230	GB2	450x600
C3	345x345	GB3	1200x600
		GB4	1500x600
		GB5	1420x600

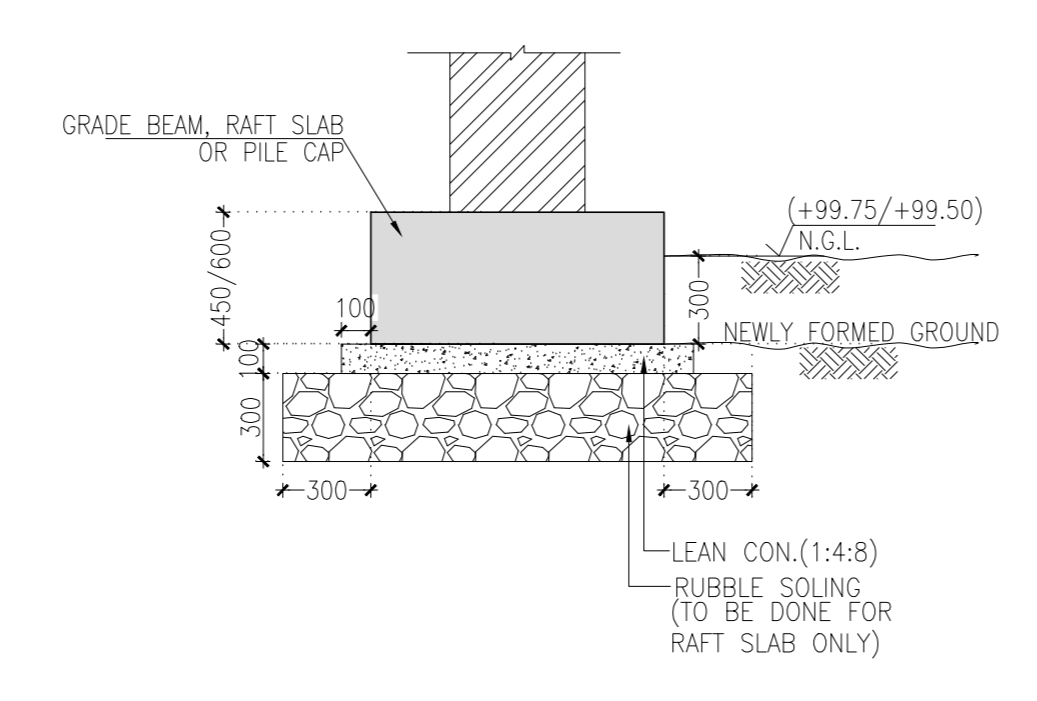

TYP. FOOTING DETAIL OF COLUMN C1/C2/C3/C4

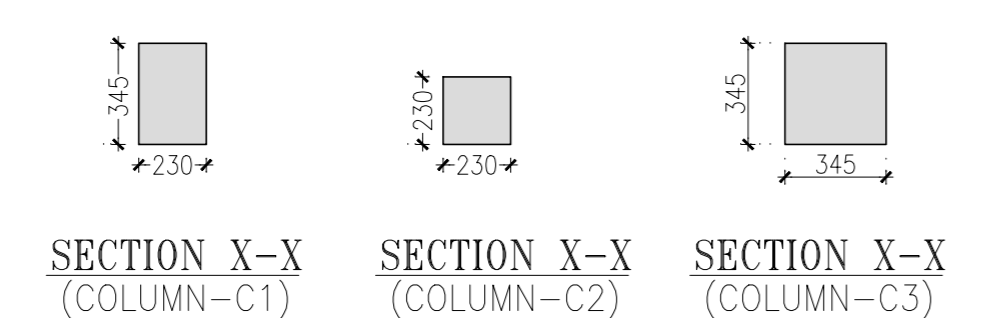

TYPICAL SECTION OF GRADE BEAM, RAFT SLAB OR PILE CAP

THIS DRAWING IS THE PROPERTY OF VINOD SHAH Consulting Engineers Pvt. Ltd. AND NOT TO BE COPIED OR USED WITHOUT THEIR PERMISSION.

NOTES:

REFERENCE: ALL DIMENSIONS TO BE CHECKED AND CORRELATED WITH ALL RELATED DRAWINGS AND ANY AMBIGUITY SHALL BE IMMEDIATELY BROUGHT TO THE NOTICE OF THE ENGINEER BEFORE COMMENCEMENT OF THE WORK.

FOUNDATION: ALL DIMENSIONS ARE MM AND LEVELS ARE IN METERS.

PILES: ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED.

FOUNDATIONS: PILING WORK TO BE DONE AS PER IS 2911-2010.

INITIAL AND ROUTINE TEST OF PILES TO BE CARRIED OUT AS PER IS 2911 (Part-04)-1985.

FINISH: FINISH ON BOTH SIDES OF WALL WHEN REQUIRED SHALL BE BALANCED IN STAGES AND LEVELS.

MASONRY SPEC: ALL MASONRY WALLS SHALL BE CONSTRUCTED FROM BURNT CLAY BRICKS UP TO SILL LEVEL WITH MIN. CRUSHING STRENGTH OF 7.5 N/mm<sup>2</sup> ON GROSS AREA UNLESS OTHERWISE SPECIFIED.

BRICK MASONRY SHALL BE BEDDED WITH CEMENT : SAND MORTAR IN PROPORTION OF 1:4 UNLESS OTHERWISE SPECIFIED.

CEB BLOCK MASONRY SHALL BE CONSTRUCTED FROM COMPRESSED STABILISED EARTH BLOCK WITH MIN. CRUSHING STRENGTH OF 7.5 N/mm<sup>2</sup> ON GROSS AREA UNLESS OTHERWISE SPECIFIED.

CEB MASONRY SHALL BE BEDDED WITH CEMENT : SAND MORTAR IN PROPORTION OF 1:4 UNLESS OTHERWISE SPECIFIED.

PROOF TEST IS RECOMMENDED TO ENSURE THE EFFICIENCY OF MASONRY WALL AGAINST COMPRESSED STABILISED EARTH BLOCK.

CONC. SPEC: ALL CONCRETE MIX M25 UNLESS OTHERWISE SPECIFIED.

REINFORCEMENT: # INDICATES TMT STEEL (Fe 500C) OF YIELD STRENGTH 500 N/mm<sup>2</sup>.

COVER: CLEAR COVER TO MAIN STEEL IS AS FOLLOWS:

- PILES : 50 mm
- PILE CAP : 80 mm
- GRADE BEAM : 30 mm
- FOOTINGS : 50 mm
- TOP : 50 mm
- BOTTOM : 50 mm
- COLUMNS & PEDESTALS : 40 mm
- BEAMS & LINTELS : 30 mm
- SLABS : 25 mm

LAP/ SPLICES: LAP LENGTH IS FIFTY TIMES BAR DIAMETER.

LEGENDS:

- Column/Wall starts from this level.
- Column/Wall stops at this level.

FOR TENDER PURPOSE ONLY

No.	Date	Remarks

Revisions

Date	Prints Issued to	Date	Prints Issued to

Distribution of Prints

- Consultants
- Structural Consultants  
VINOD SHAH Consulting Engineers Pvt. Ltd.
  - Services Consultants  
DBHMS
  - Landscape Consultants  
Earthscapes Consultancy Pvt Ltd
  - Road and Pathways Consultants  
Aahm Infra Consultants LLP

Project  
Nalanda University, Rajgir, Bihar

Title  
STRUCTURAL G.A. DRAWINGS OF GRADE BEAM LAYOUT & DETAILS FOR STUDENT HOUSING (TYPE-13)

Dealt : HS  
Checked : AJ  
Date : 09/06/2016

Drawing No.  
NUC-RSH - S - A.13.2

VASTU SHILPA CONSULTANTS  
Architects | Planners | Urban Designers

Sangam, Thaha Road, Arrah, Bihar - 80054  
Phone: 079-2745437 Fax: 079-2745206  
www.sangam.org e-mail: vsc@sangam.org